

NOTES:

1. USE FOR SERVICE CONNECTION WHEN SANITARY SEWER DEPTH EXCEEDS 12.0 FEET.
2. FACTORY TEES OR WYES SHALL BE USED ON NEW CONSTRUCTION.
3. LONGITUDINAL DIMENSIONS OF GRANULAR BEDDING AROUND RISERS OR TEE/WYE CONNECTIONS SHALL BE NOT LESS THAN 1'-6"


SEE SHEET 2 FOR ADDITIONAL DETAILS.

1	01/25/01	
REV.	DATE	BY
DATE:	01-01-98	


TYPICAL SANITARY SEWER SERVICE STUB

FIGURE: 4010.1


SHEET 1 OF 2

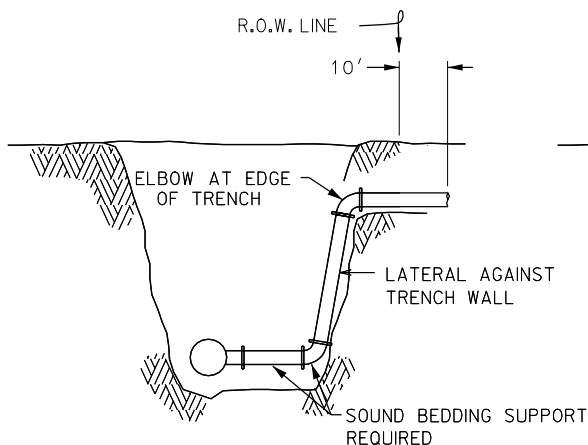


A) FOR MODERATE TRENCH DEPTH

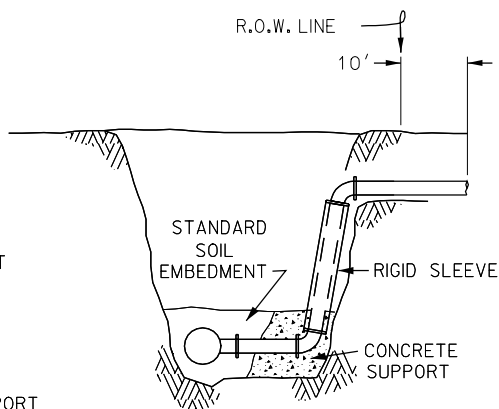

B) RIGID SLEEVE FOR ANY TRENCH DEPTH
(CONCRETE MUST SUPPORT SLEEVE)

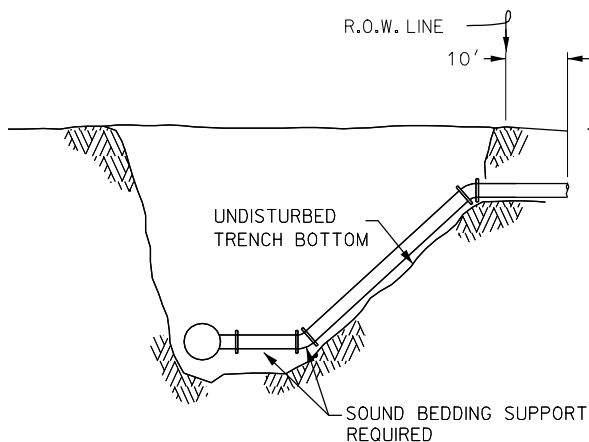

C) SLOPING LATERAL TRENCH-ANY DEPTH
(SLOPE AT 1:1 OR FLATTER)

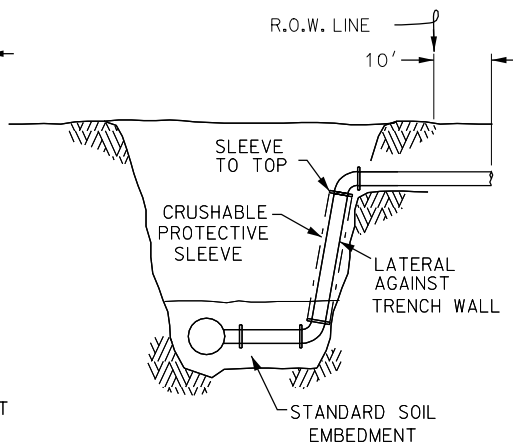

D) CRUSHABLE SLEEVE-ANY DEPTH
(SLEEVE OF NEAR ZERO COLUMN STRENGTH)

I	01/25/01		TYPICAL SANITARY SEWER SERVICE STUB	FIGURE: 4010.I
REV.	DATE	BY		
DATE: 01-01-98				
				SHEET 2 OF 2